



ANNE ARUNDEL COUNTY

MARYLAND DEPARTMENT OF HEALTH

Bureau of Environmental Health
3 Harry S. Truman Parkway
Annapolis, MD 21401
Phone 410-222-7193 Fax 410-222-7479
Maryland Relay (TTY): 711
www.aahealth.org

Frances B. Phillips, R.N., M.H.A.
Acting Health Officer

May 2, 2018

ARTHUR G WILLIAMS
3600 PREDDY CREEK ROAD
CHARLOTTESVILLE, VA 22911

RE: Perc #T02045819
Tax Account #224012415075
Site: 455 HOENERENG TRAIL
ANNAPOLIS

This letter does not constitute Health Department or Building Permit approval for the referenced site. The Anne Arundel County Department has completed an evaluation of the above referenced property. Percolation test(s) were conducted on April 23, 2018. Minimum design requirements are based on a proposed house size no larger than 3500 square feet and the test results. The minimum design requirement for the initial septic system and replacement systems are as follows:

Septic Tank BAT

Initial Drywell/Seepage Pit:

Test # 100
Total Depth 46 feet
Diameter 6 feet
No. of Pits 1
Pits Separated by 18 feet from edge to edge

Replacement systems:

Test # 100
Total Depth 46 feet
Diameter 6 feet
No. of Pits 1
Pits Separated by 18 feet from edge to edge

Other: PUBLIC WATER

A nitrogen reducing pretreatment unit will be required with the design of the sewage disposal system. The reason for this requirement this property is located in the Chesapeake Bay watershed as required by COMAR 26.04.02.07.

The minimum design requirements listed above are for the purpose of preparing site plans for the referenced property


Before approval of a septic system for this property is considered, eight (8) copies of a site plan should include; all items on the site plan requirement sheet, a nitrogen reducing pretreatment unit if required and the layout of the proposed initial septic system and replacement(s) must be prepared by the owner/applicant and submitted to this office for review.

May 2, 2018
T02045819
Page -2-

The referenced perc application will expire two (2) years following the date received by this department.

If you have any questions regarding the above please call Sanitary Engineering at (410) 222-7070.

Sincerely,

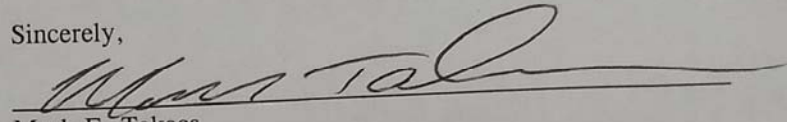A handwritten signature in black ink, appearing to read "Mark Takacs", written over a horizontal line.

Mark E. Takacs
Sanitary Engineering
Bureau of Environmental Health

cc: Owner

BRF# _____

PERC APPLICATION NO: 702045819

PRIOR PERC(S): YES NO

SOIL TYPE: _____

SEWER SERVICE CATEGORY: _____

WET SEASON RESTRICTED? YES NO
 TESTED IN WET SEASON: YES NO


CRITICAL AREA? YES NO BOG? YES NO
 100' FROM WATERWAY? YES NO

EXISTING HOUSE SIZE 900 # OF BEDROOMS: _____ # OF BATHROOMS _____
 PROPOSED HOUSE SIZE <3500 # OF BEDROOMS: _____ # OF BATHROOMS _____

DATE TESTED/INSPECTED: 4-23-18 SANITARIAN TRAVIS

PERSONS PRESENT DURING TEST Jones

SOIL TEST/SITE EVALUATION

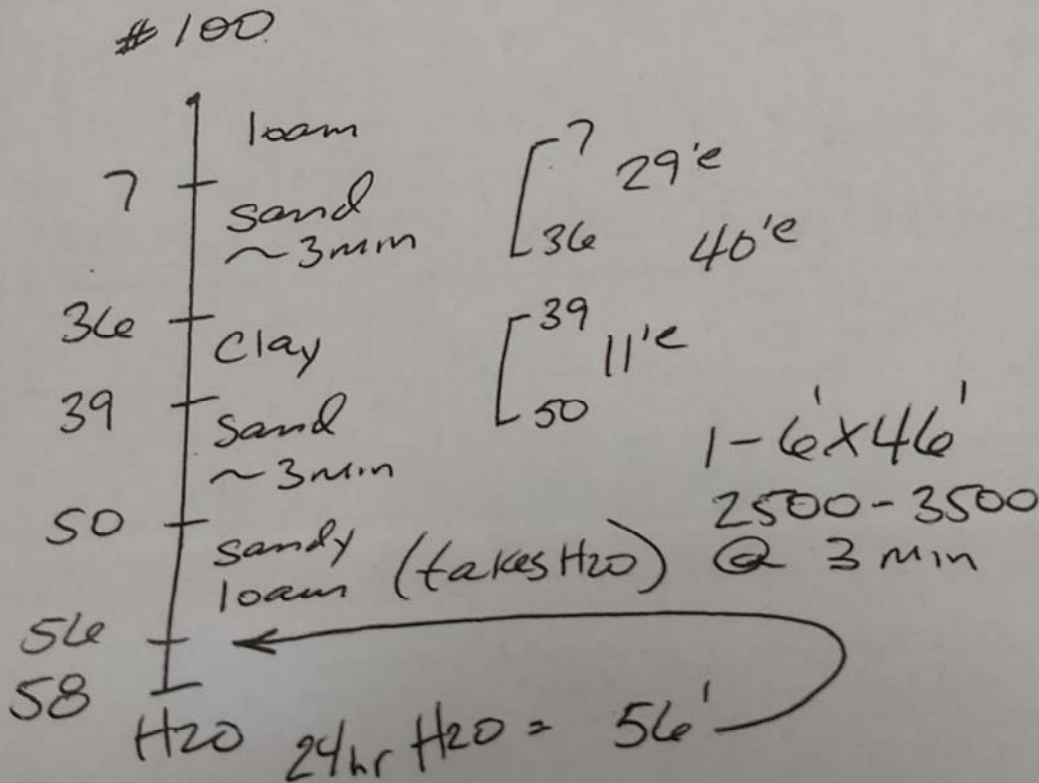

WATER CONDITIONER? YES NO

LOCATION OF BACKWASH DISCHARGE _____

HOUSE OCCUPIED? YES NO

NUMBER OF OCCUPANTS _____

FAILING SYSTEM? YES NO OVERFLOW BACK-UP COLLAPSED TANK

OTHER/COMMENTS: _____

BRF FUNDING PRIORITY (1-6): _____

BRF FINANCIAL QUALIFICATION: _____ % NUMBER OF OWNERS: _____ TAX YEAR: _____ INITIALS: _____

BRF VENDOR CONTRACT RECEIVED EARLY? DATE: _____ UNIT TYPE: _____